NOTE: WATER SERVICES SHALL NOT BE ALLOWED IN DRIVEWAY APPROACH AREAS AT ANY RESIDENTIAL LOCATION.

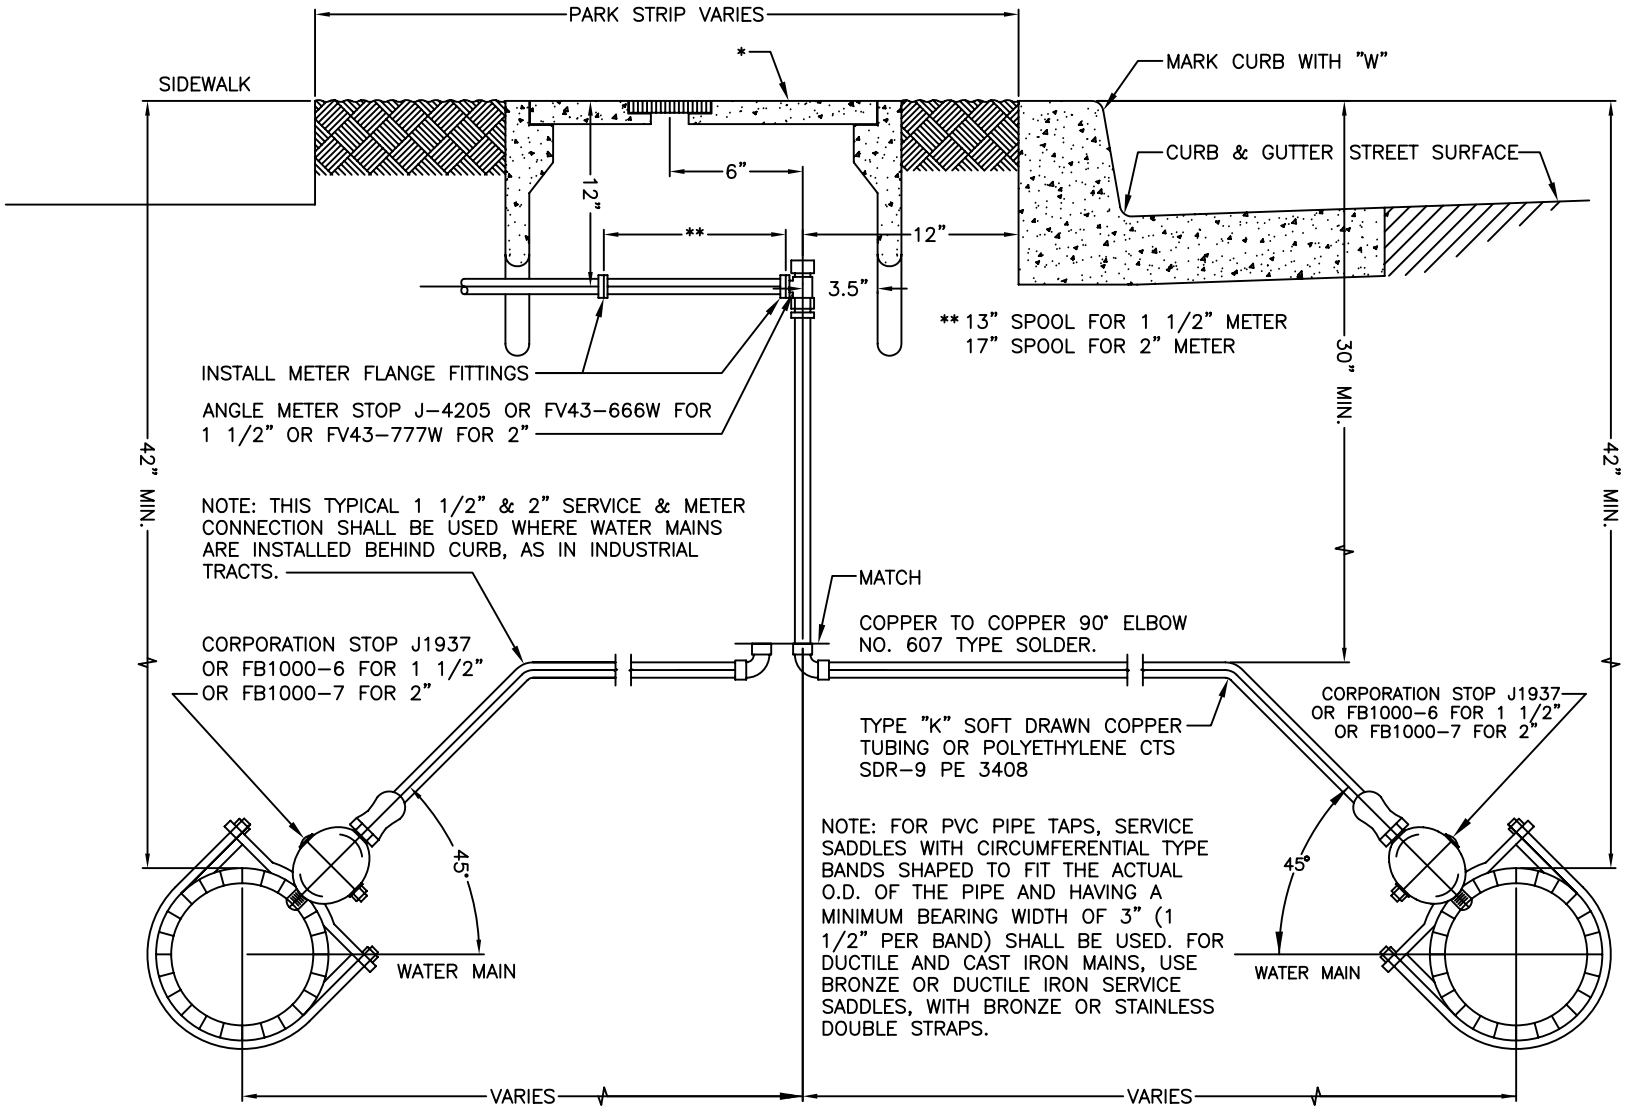


NOTE: USE COMPRESSION JOINT WITH SSTL INSERT ON PE PIPE. MIN.1½ WATER SERVICE AND METER SHALL BE REQUIRED ON A LOT SIZE OF 20,000 S.F. AND LARGER.

*TRAFFIC RATED LID TO BE USED WHEN METER IS LOCATED IN ALLEYS, DRIVEWAYS OR ROLLED CURB AREAS.

| METER BOX SPECIFICATIONS | | |
|---|---|---|
| CHRISTY | | BROOKS |
| 1 1/2" B30 BOX WITH B30G LID | OR | 1 1/2" NO. 38 WITH NO. 38 "H" COVER & CAST IRON LID |
| 2" B36 BOX WITH B36E LID | OR | 2" NO. 66 WITH NO. 66 "S" COVER & NO. 66 "S" LID |

# 1 ½" & 2" SERVICE CONNECTION & METER BOX INSTALLATION

REF. & REV.
OCT., 2009

CITY OF FRESNO

W-1