


PLAN

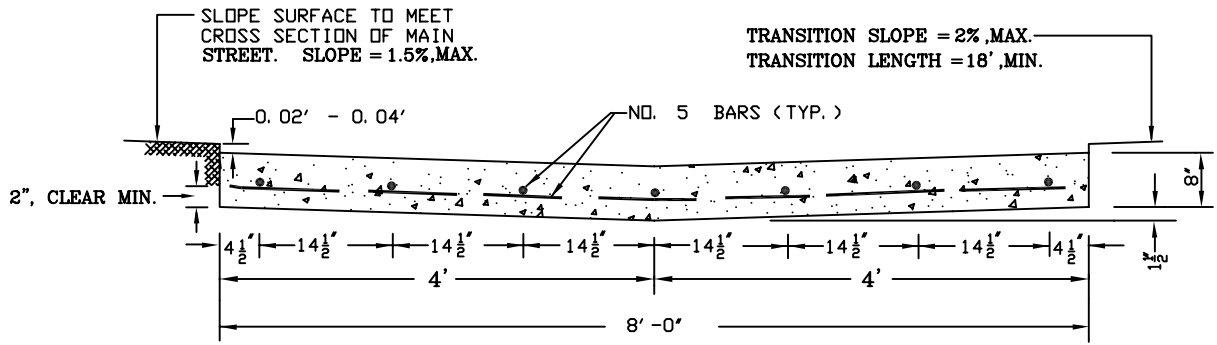

- NOTE: 1) IN NEW CONSTRUCTION AREAS, VALLEY GUTTERS SHALL BE DESIGNED TO PROVIDE A MINIMUM DIFFERENCE OF THIRTY-FIVE HUNDREDTHS OF A FOOT (.35') FROM END OF RETURN TO END OF RETURN.
- 2) ALL VALLEY GUTTERS SHALL BE CONSTRUCTED USING 6 SACK CLASS A CONCRETE PER STD. SPECIFICATIONS 14-2

SECTION OF GUTTER