


* **OPTIONAL:**
DASHED BOX INDICATES 8" AREA OF 3/4" - 1" GRAVEL AROUND EMITTER IN PLACE OF PVC SLEEVE.

EMITTER DETAIL

PIPE DETAIL

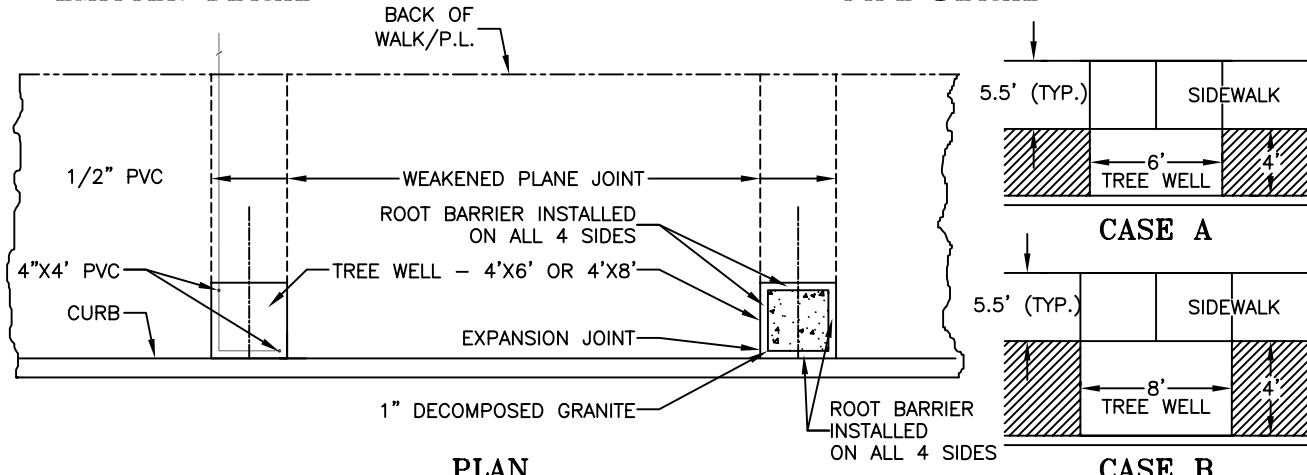

PLAN

CASE B

NOTES:

1. FORM LUMBER FOR TREE WELL SHALL BE 2" X 4".
2. NO TREE WILL BE PLANTED UNLESS WATER IS PROVIDED TO PLANTER AREA.
3. 1" DECOMPOSED GRANITE IS REQUIRED WHEN TREE PLANTING IS NOT IN CONJUNCTION WITH PROJECT.
4. ALL DRIP SYSTEMS SHALL BE EQUIPPED WITH 200 MESH FILTER, PRESSURE REGULATOR, AND A CLEAN OUT TO FLUSH THE SYSTEM ANNUALLY.
5. ALL PLASTIC TUBING UNDER CONCRETE SHALL BE 1/2" PVC CLASS 125 OR BETTER AND SLEEVED AT 2.5 TIMES THE DIAMETER OF THE PIPE.
6. TIMECLOCK SHALL HAVE THE CAPACITY TO BE SET TO 40 MINUTES PER IRRIGATION STATION DURING THE MONTHS OF JULY AND AUGUST AND PROPORTIONAL TO CLIMATIC CONDITIONS FOR THE REMAINDER OF THE YEAR.
7. MAINTAIN 4' CLEAR SIDEWALK WIDTH BETWEEN TREE WELL AND BACK OF SIDEWALK.