CONSTRUCTION DETAILS FOR CONCRETE SIDEWALK, CURB & GUTTER

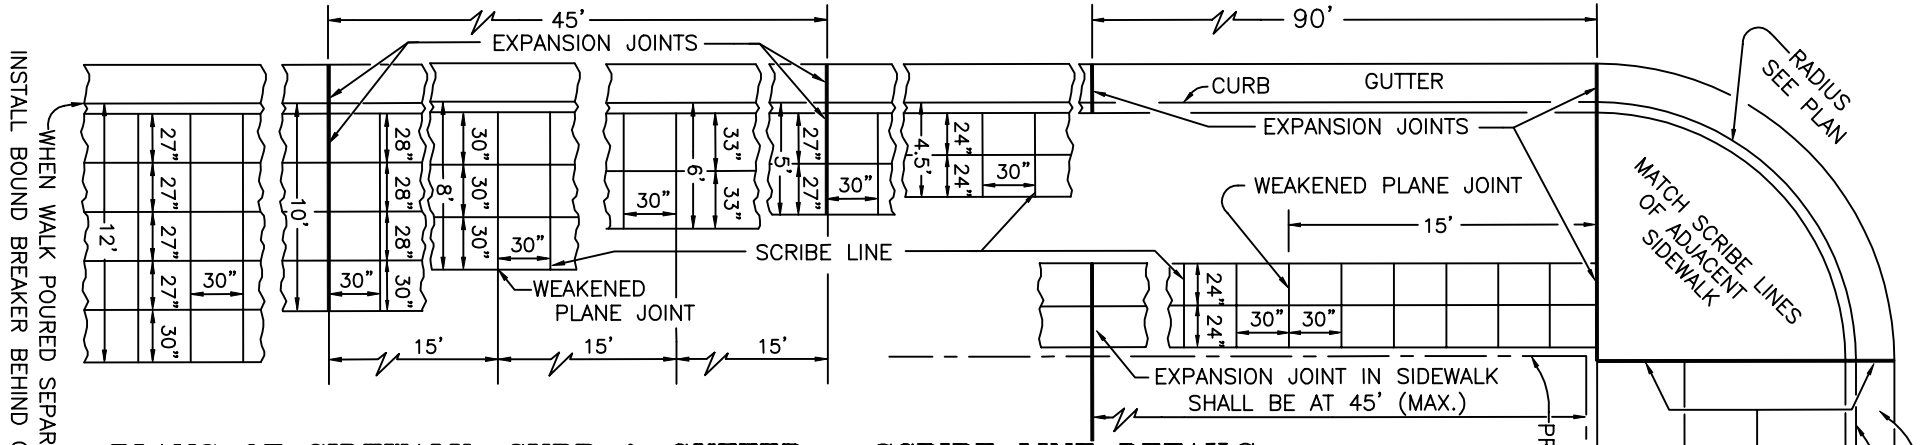

PLANS OF SIDEWALK, CURB & GUTTER – SCRIBE LINE DETAILS

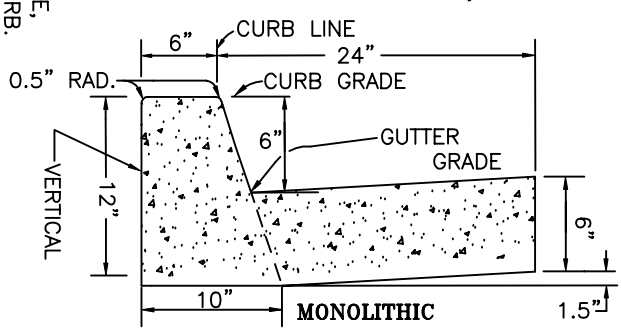

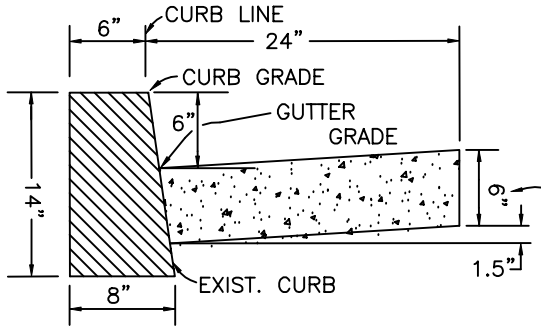

SECTIONS OF CURB & GUTTER

NOTE: WHEN REQUIRED BY THE ENGINEER THE CONTRACTOR SHALL FILL AND/OR GRADE AREA BETWEEN NEW GUTTER AND EXISTING STREET SURFACE WITH A.C. SURFACING TO A MIN. DEPTH OF 4" TO MEET EXISTING STREET SURFACING. COMPACTION SHALL BE MADE TO THE SATISFACTION OF THE ENGINEER. CLEAN FACE OF EXIST CURB BEFORE POURING CONCRETE GUTTER.

6"TYP. (RESIDENTIAL)

NOTE: WHERE SIDEWALK IS NOT CONSTRUCTED, CUT OR FILL FROM 1" BELOW TOP OF CURB TO PROPERTY LINE AT A SLOPE OF 1/4" PER FOOT. A STEEPER SLOPE OF UP TO 10% MAY BE USED IN EXISTING RESIDENTIAL NEIGHBORHOODS WHERE (1) THE CONSTRUCTION OF SIDEWALK IS NOT EXPECTED IN THE FUTURE, (2) THE STEEPER SLOPE IS COMPATIBLE WITH THE ADJACENT PROPERTY, AND (3) THE STEEPER SLOPE WILL ELIMINATE THE NEED FOR A RETAINING WALL. SLOPES IN EXCESS OF 10% MAY BE APPROVED BY THE PUBLIC WORKS DIRECTOR ON A CASE-BY-CASE BASIS.

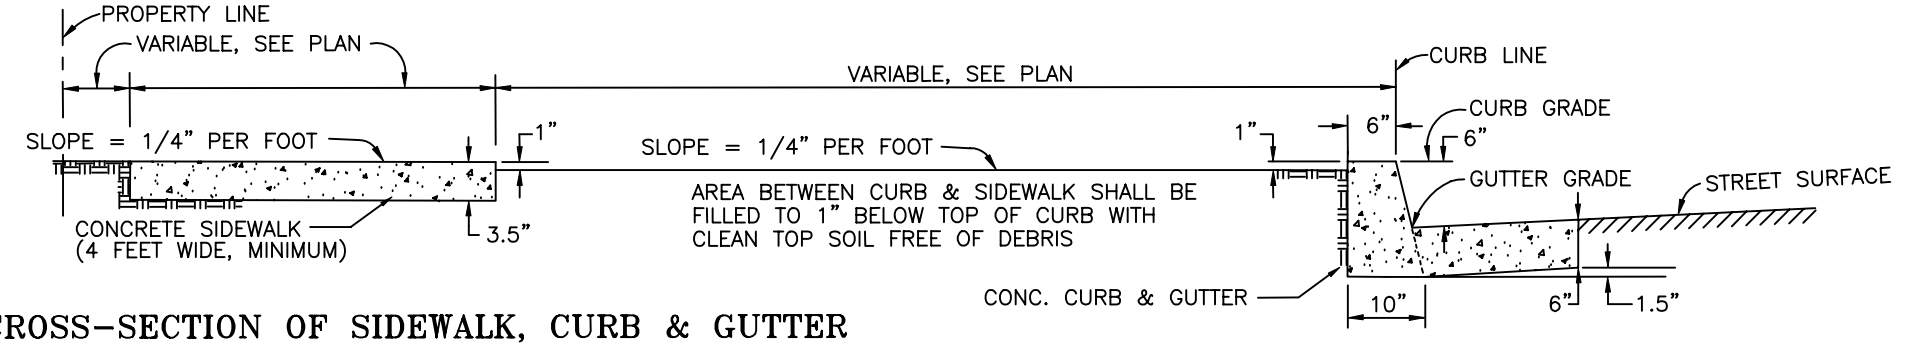

CROSS-SECTION OF SIDEWALK, CURB & GUTTER

REF. & REV. AUG. 2002

CITY OF FRESNO

P-5