1" SERVICE CONNECTION & METER BOX INSTALLATION

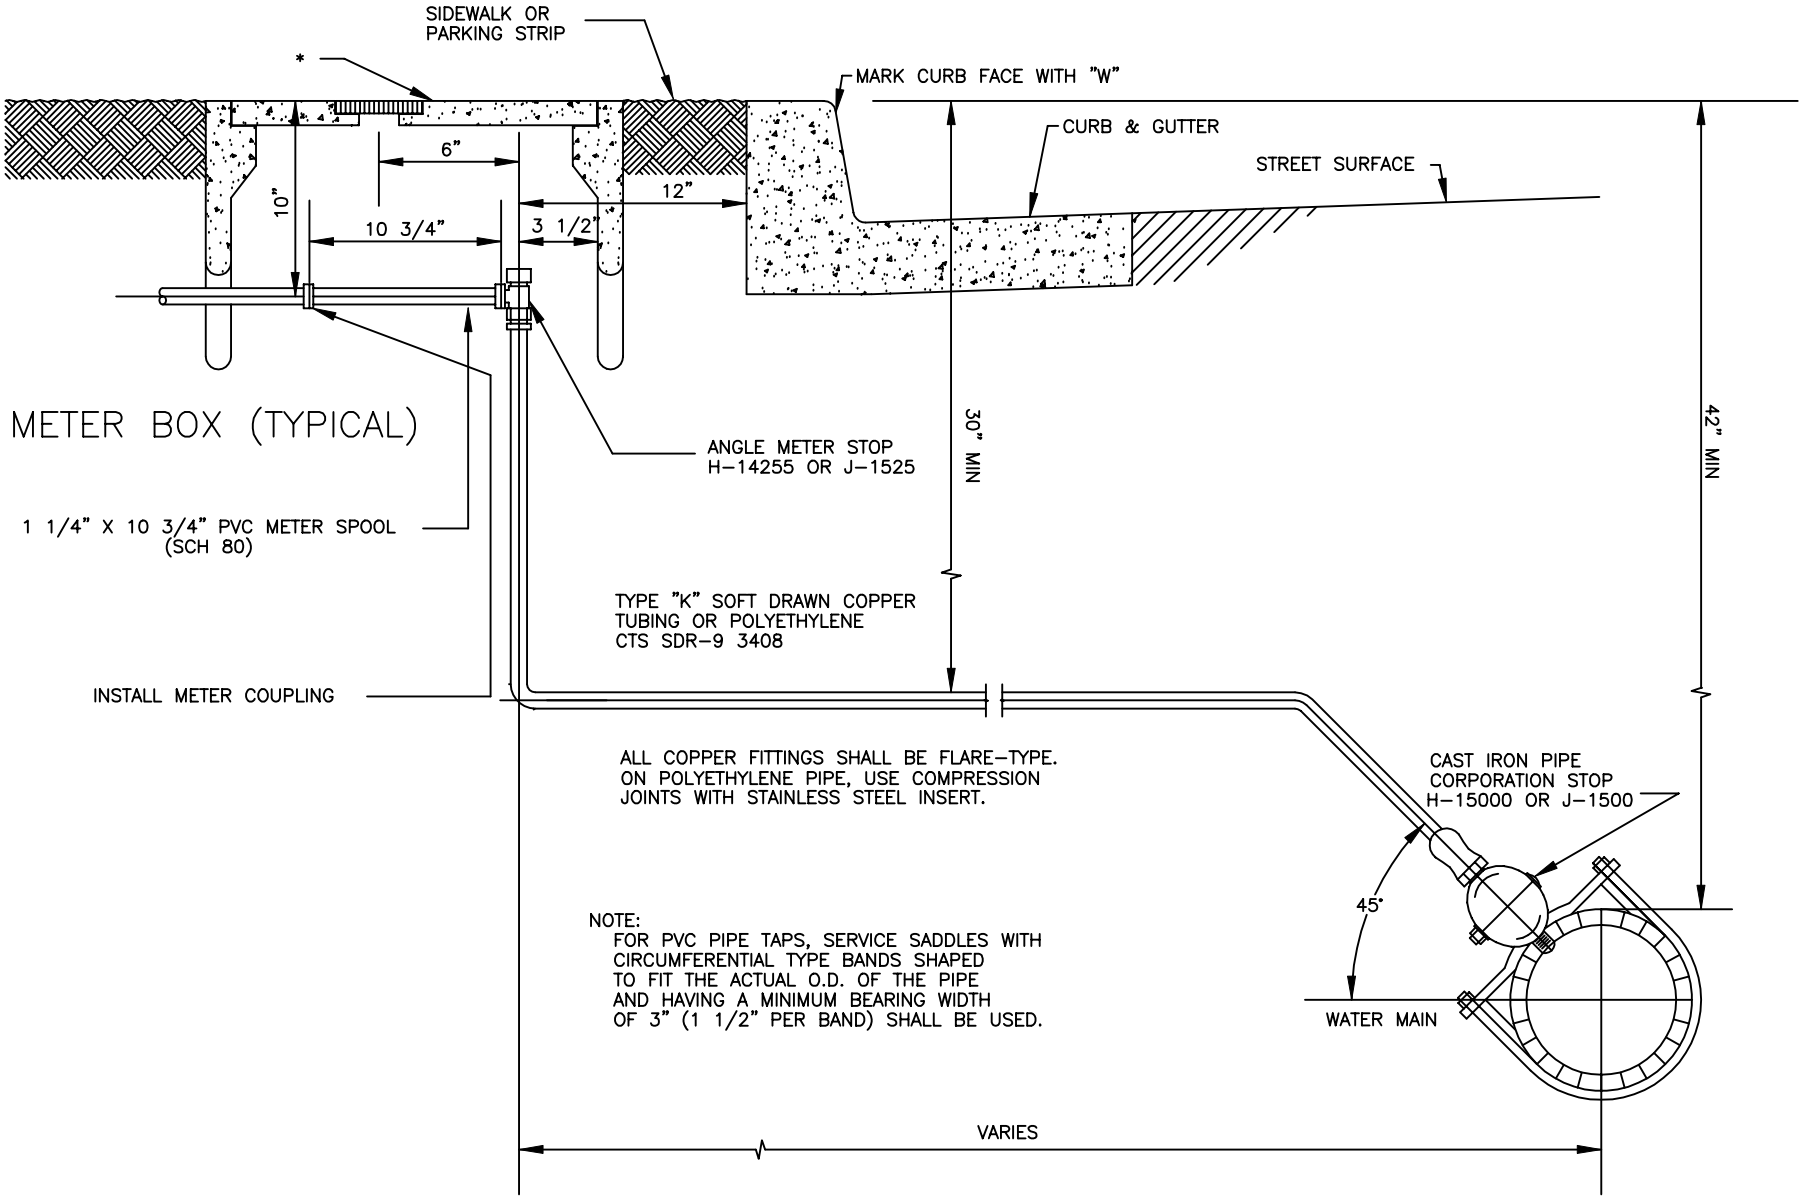

NOTE:
FOR PVC PIPE TAPS, SERVICE SADDLES WITH CIRCUMFERENTIAL TYPE BANDS SHAPED TO FIT THE ACTUAL O.D. OF THE PIPE AND HAVING A MINIMUM BEARING WIDTH OF 3" (1 1/2" PER BAND) SHALL BE USED.

NOTE:
WATER SERVICES SHALL NOT BE ALLOWED IN DRIVEWAY APPROACH AREAS AT ANY RESIDENTIAL LOCATION.

* NO. 37 "T" CAST IRON TRAFFIC COVER TO BE USED WHEN METER IS LOCATED IN ALLEYS OR DRIVEWAY AREAS.

METER BOX SPECIFICATIONS		
CRISTY (FORNI DIV.) B16 WITH G30 LID	OR	BROOKS NO. 37 WITH NO. 37 "H" COVER & CAST IRON LID.

REF. & REV.
AUG. 2002

CITY OF FRESNO

W-2