



PREVENTION MANUAL
FIRE EXTINGUISHING SYSTEMS
405.20 CPVC HANGER SPACING
EFFECTIVE: SEPTEMBER 2013

SCOPE


Hanger installation requirements for CPVC fire sprinkler systems (two point restraint).

PURPOSE

The purpose of this policy is to clarify the required two point restraint pipe hanger installation locations and distances for fire sprinkler systems utilizing CPVC piping.

REQUIREMENTS

The following diagram notes the required two point restraint pipe hanger locations and distances for fire sprinkler systems utilizing CPVC piping.

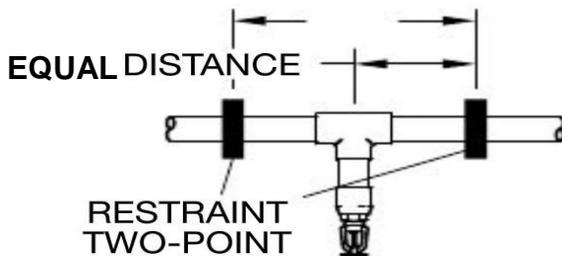

Hangers shall be spaced an equal distance from the "T", not to exceed the required overall spacing.

This policy helps eliminate confusion for system installers and provides the best method for installation regardless of pipe manufacturer.