


JULY 2016

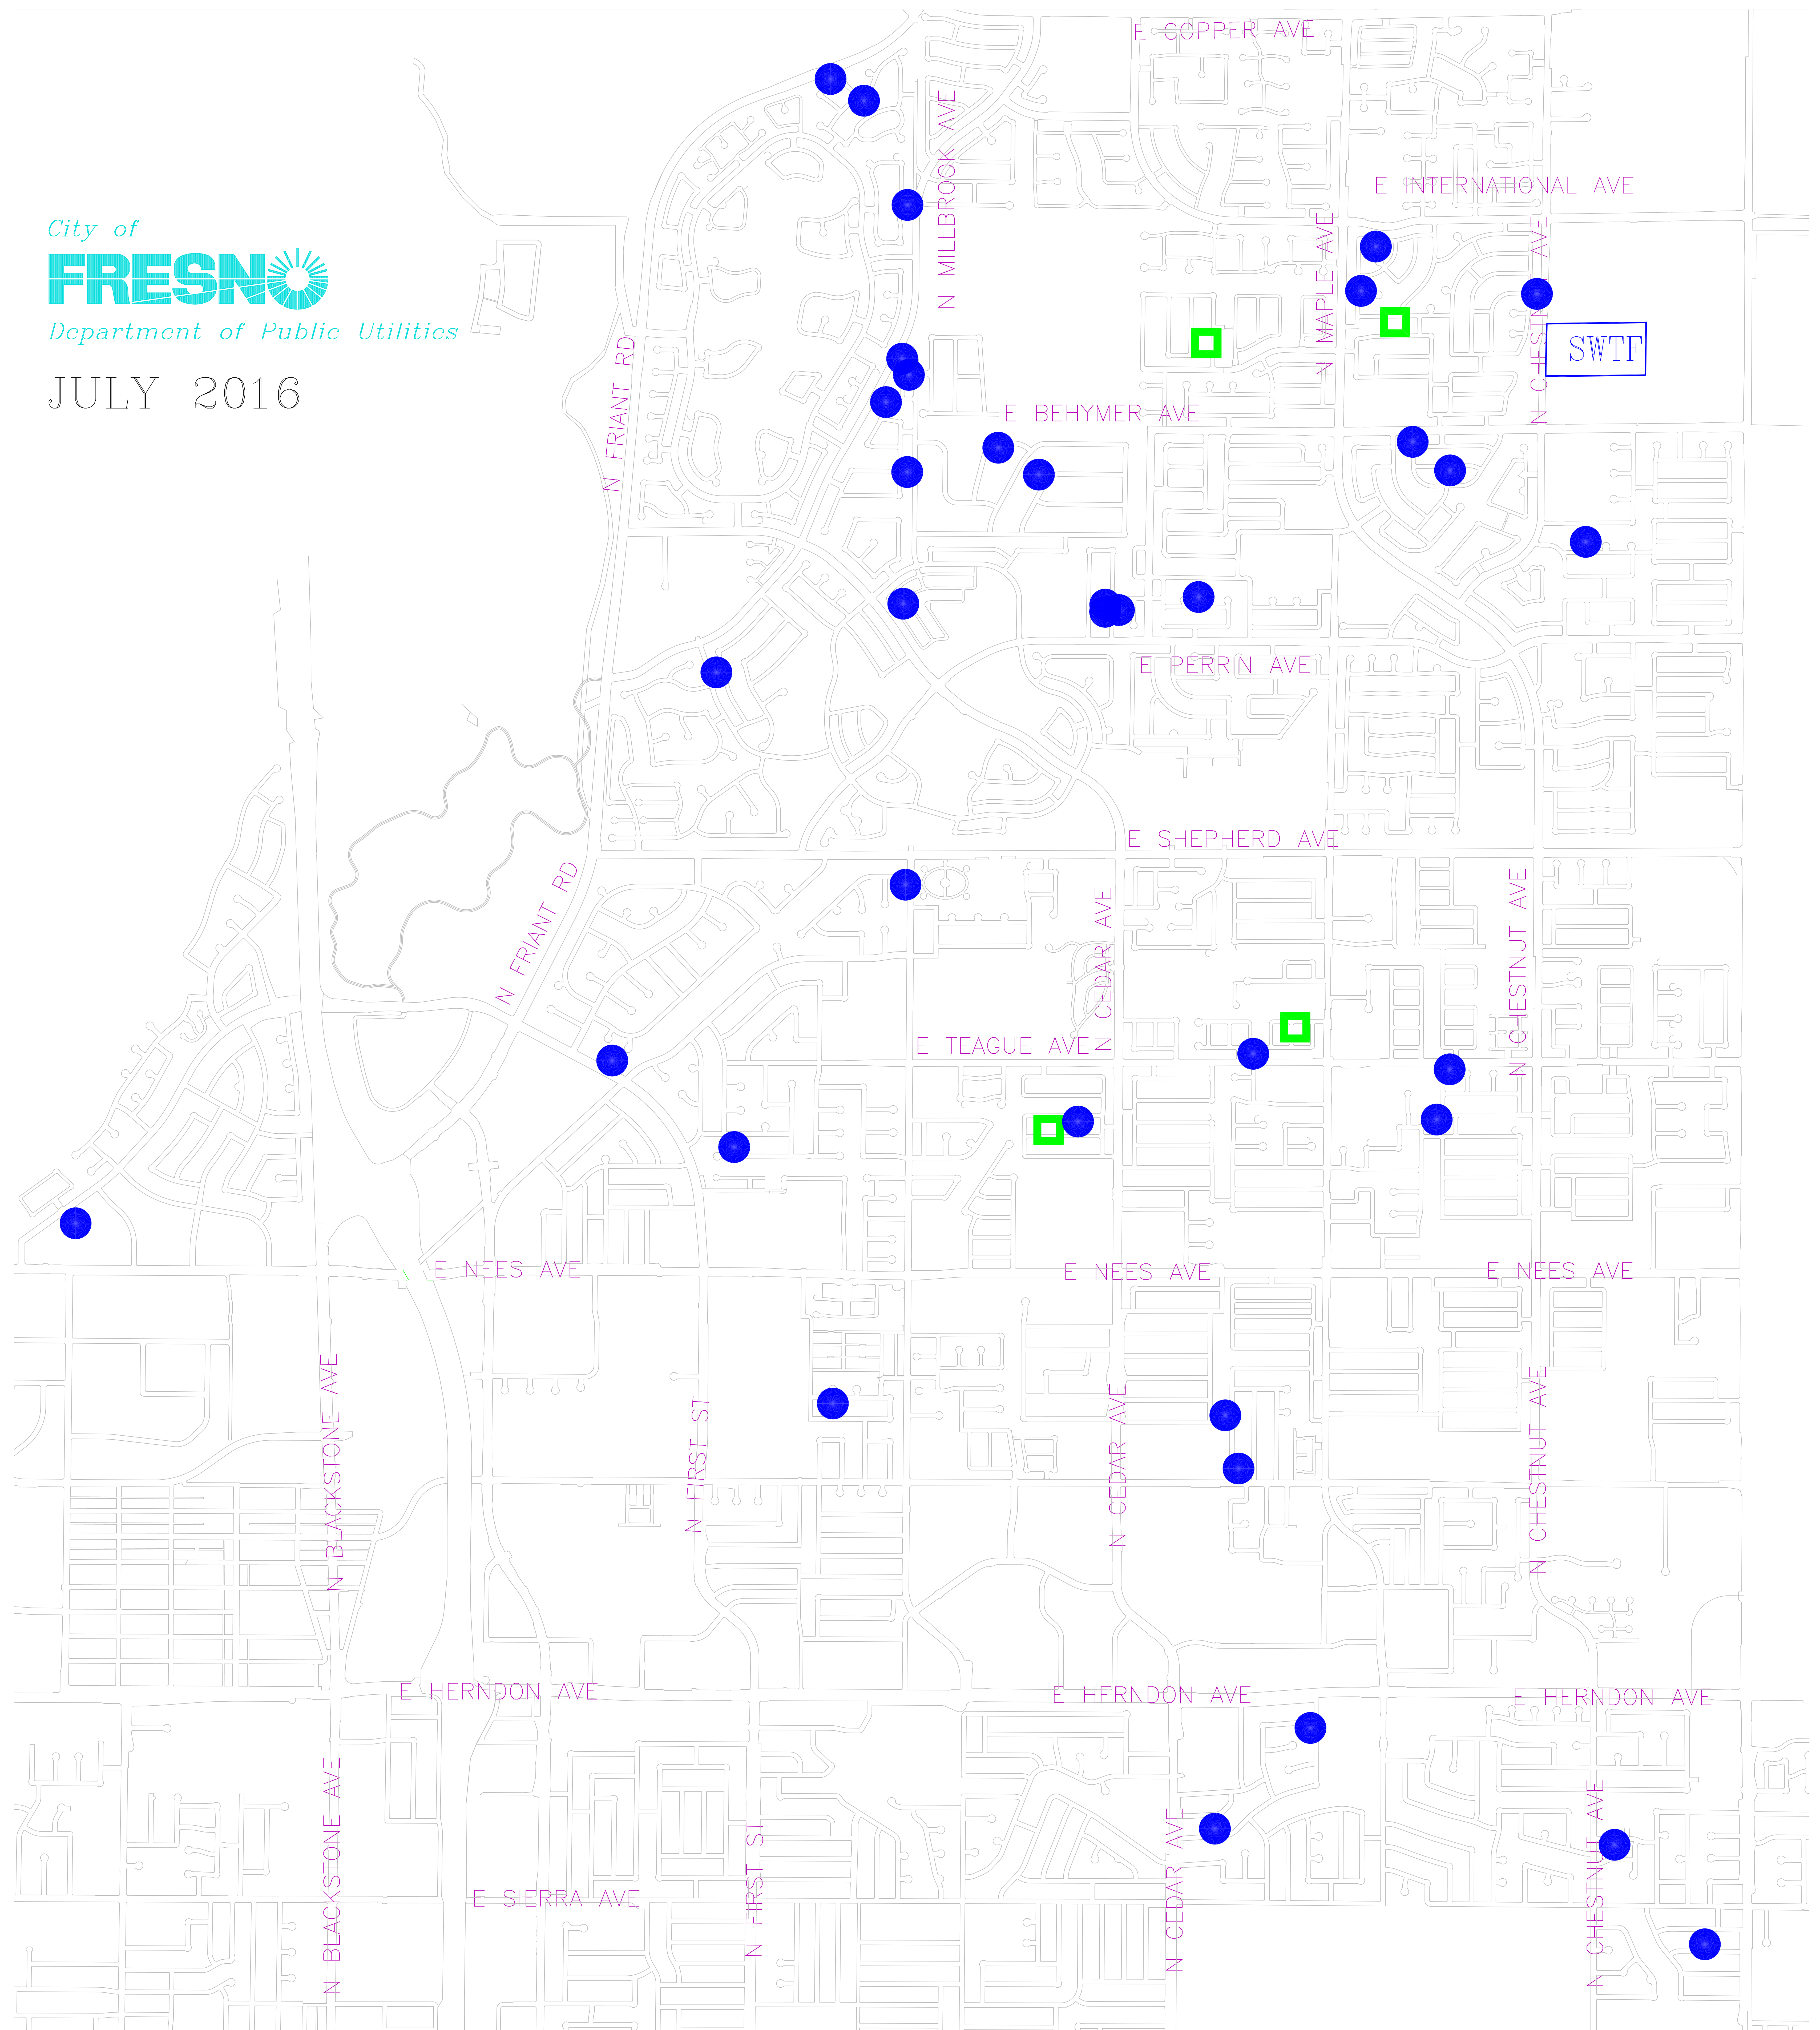

*Homes Currently Reporting Lead Concentrations
Above the Action Level
(First Draw Samples), July 28 2016*

Lead Concentration Above Action Level at Kitchen Sink

Lead Concentration Above Action Level at Non-Kitchen Sink, Indoor Fixture